



Purchasing Department

140 Stonewall Avenue West, Ste 204
Fayetteville, GA 30214
Phone: 770-305-5420
www.fayettecountyga.gov

August 30, 2021

Subject: Request for Quote #1995-A: Replace Chiller Water Coil at the Library -Addendum #1

Gentlemen/Ladies:

Below, please find additional information for the above referenced Request for Quote. You will need to consider this information when preparing your Quote.

Questions received at the Pre-Quote meeting:

1. Are there any specifications or performance information for the existing coil?

Yes, the model information is attached as Exhibit A.

2. Is Propress acceptable for the pipe?

Yes

3. Is there a place where equipment can be stored?

Yes, Area by the chiller, south-side of the building

4. Does the coil / blowers need to be OM?

No

5. With the availability of supplies what is the due date of the work?

The work shall be done between November 1, 2021 through February 28, 2022.

6. Does the vendor need to replace the missing insulation?

Yes

7. Is the motor staying in place?

Yes


Received by _____ Company _____

Note: Please sign and return this addendum with your submitted quote. Any respondent not returning a signed addendum will still be responsible for compliance with any requirements, specifications, or changes contained in the addendum.

The due date and time remain the same. Quotes will be accepted until 2:00 pm, Thursday, September 2, 2021. The time allowed for questions has expired.

Thank you for your attention to this matter.

Sincerely,

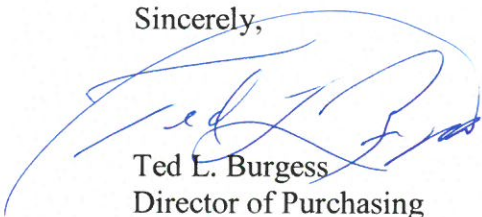A handwritten signature in blue ink, appearing to read "Ted L. Burgess", is written over the typed name and title.

Ted L. Burgess
Director of Purchasing

TLB\tc


Exhibit A



Installation CLCH-IM-15A Maintenance

Library	Service Literature
Product Section	Air Handling
Product	Central Station Air Handlers
Model	Modular Climate Changer
Literature Type	Installation/Maintenance
Sequence	15A
Date	January 1992
File No.	SV-AH-CLCH-CLCH-IM-15A-192
Supersedes	CLCH-IM-15

Modular Climate Changer® Central Station Air Handlers

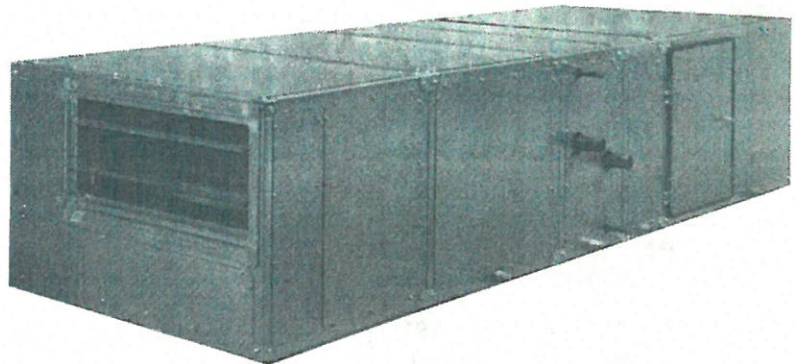

Draw-Thru and Blow-Thru Unit Sizes
3, 6, 8, 10, 12, 14, 17, 21, 25, 30
35, 40, 50, 66, 80, and 100